


**PERMANENT SERVICE-UNDERGROUND  
FIGURE 6B**

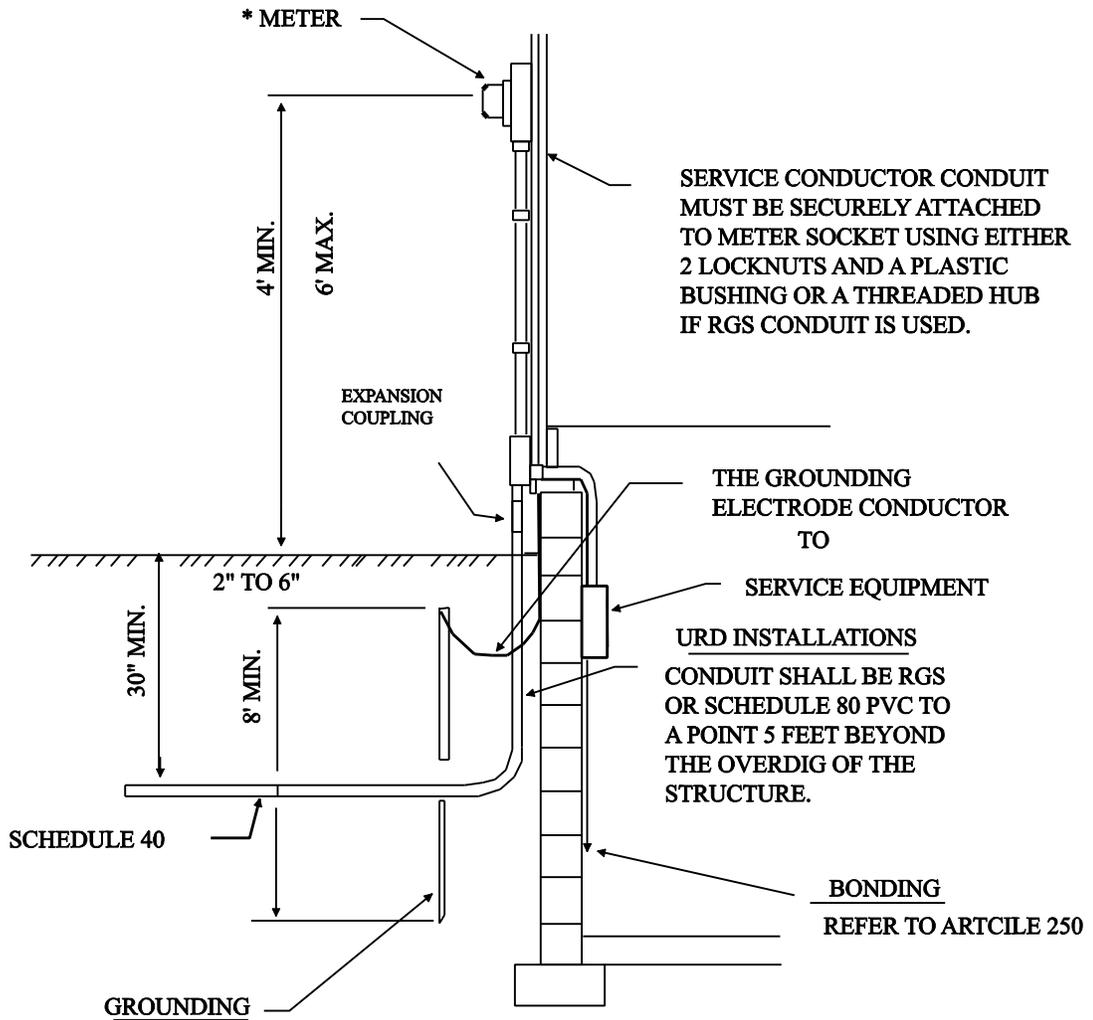

AS REQUIRED BY THE NATIONAL ELECTRIC CODE FOR GROUNDING ELECTRODE SYSTEMS. SEE ARTICLE 250-81.

**NOTES:**

- \* 1. Supplied and installed by the utility.