


TYPICAL GROUP METERING SIX OR LESS METERS FACTORY FABRICATED
FIGURE 7A

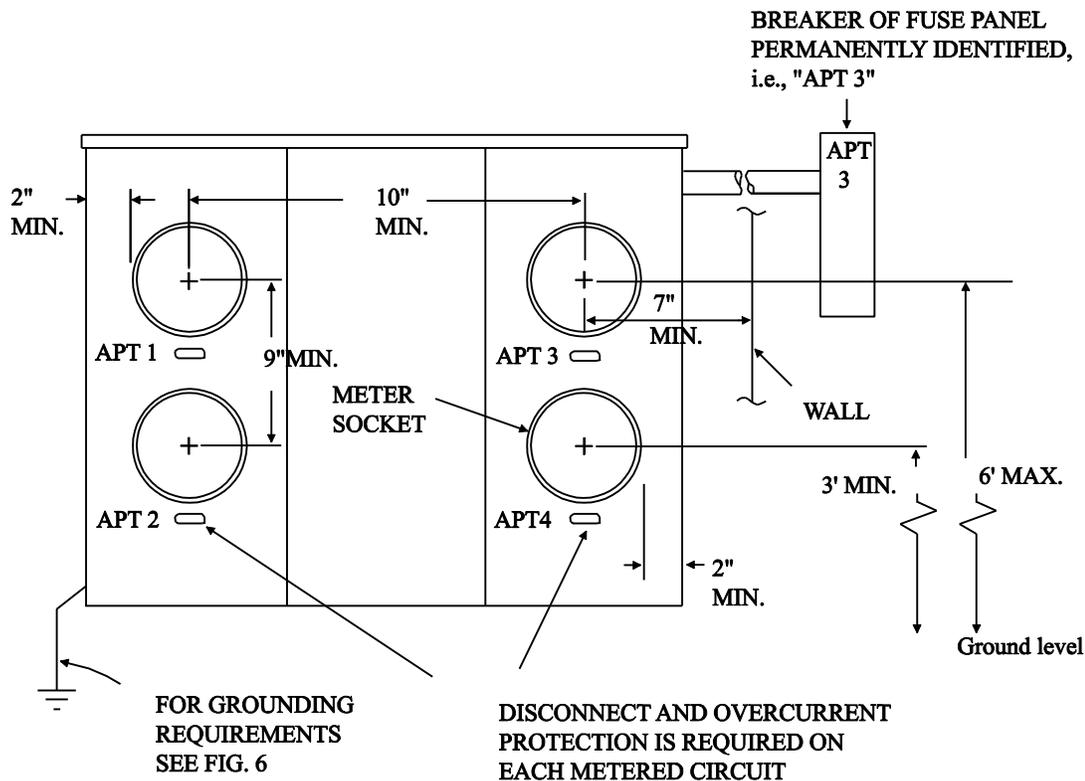

1. All service entrance equipment shall be UL listed.
2. Working space in front of service entrance equipment and meter sockets shall be in accordance with NEC Section 110-16
3. Apartments shall have identical markings on the entry door, meter socket, and fuse or breaker panel.