TEMPORARY SERVICE UNDERGROUND
FIGURE 5A

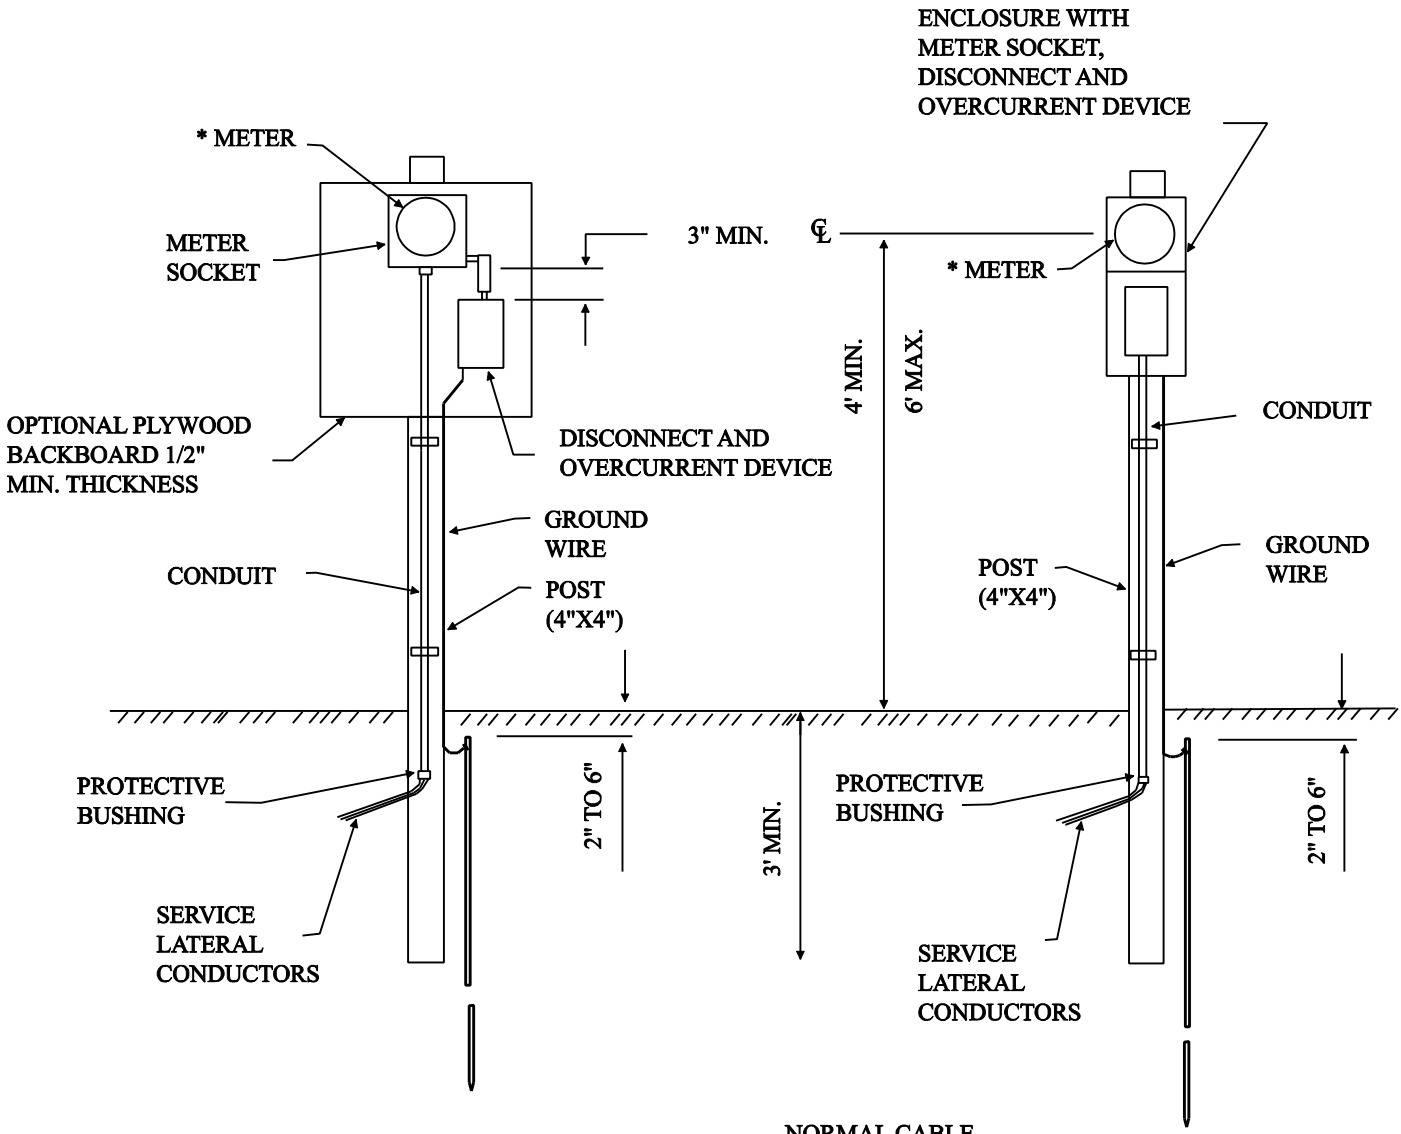

TEMPORARY METER SETTING RELATIVE TO TRANSFORMER PAD OR SECONDARY PEDESTAL

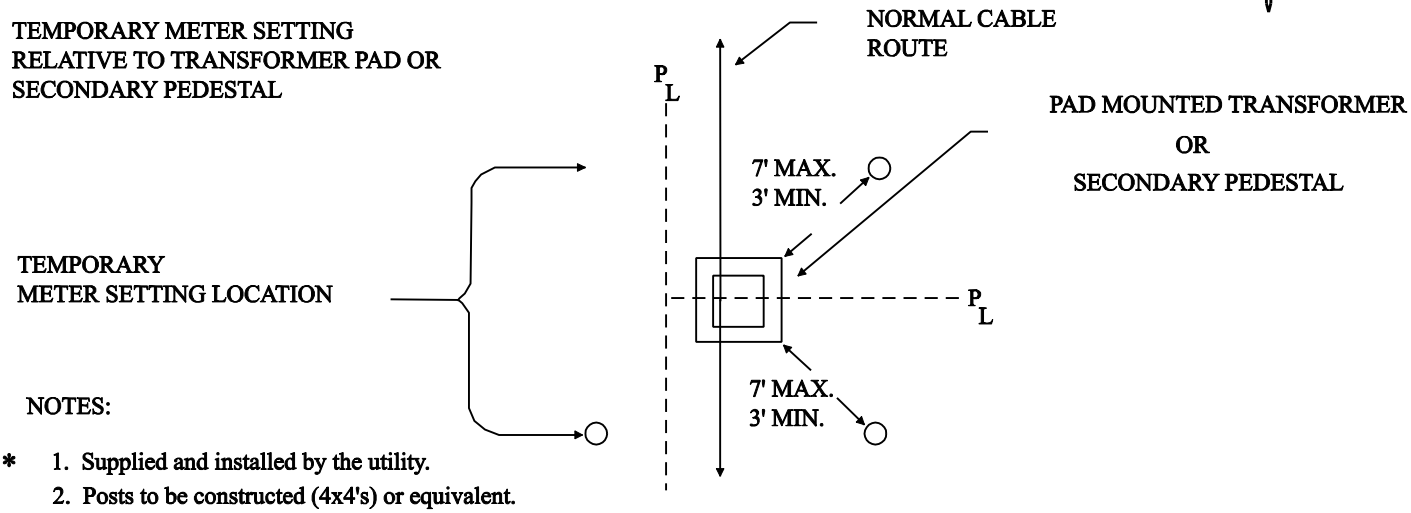

NOTES:

* 1. Supplied and installed by the utility.

2. Posts to be constructed (4x4's) or equivalent.

3. Service lateral conductors to be suitable for direct burial and of sufficient length to connect to the service source.

4. 30" trench from pedestal or transformer to meter setting by contractor.